

Current Transducer HTB 100-TP/SP9

For the electronic measurement of currents: DC, AC, pulsed..., with galvanic separation between the primary circuit and the secondary circuit.



$$I_{PN} = 100 \text{ A}$$



Electrical data

I_{PN}	Primary nominal RMS current	100	A
I_{PM}	Primary current, measuring range	± 500	A
U_{out}	Output voltage (Analog) @ $\pm I_{PN}$, $R_L = 10 \text{ k}\Omega$, $T_A = 25 \text{ }^\circ\text{C}$	± 1	V
R_{out}	Output internal resistance	100	Ω
R_{INS}	Insulation resistance @ 500 V DC	> 500	M Ω
R_L	Load resistance	≥ 10	k Ω
U_C	Supply voltage ¹⁾	$\pm 12 \dots 15$	V
I_C	Current consumption	< ± 15	mA

Accuracy - Dynamic performance data

ε	Error @ I_{PN} , $T_A = 25 \text{ }^\circ\text{C}$ (excluding offset)	< ± 1	%
ε_L	Linearity error (0 ... $\pm I_{PN}$)	< ± 1	%
U_{OE}	Electrical offset voltage @ $T_A = 25 \text{ }^\circ\text{C}$	< ± 30	mV
U_{OM}	Magnetic offset voltage @ $I_p = 0$, after an excursion of $3 \times I_{PN}$	< ± 10	mV
TCU_{OE}	Temperature coefficient of U_{OE}	< ± 1	mV/K
TCU_{out}	Temperature coefficient of U_{out} (% of reading)	< ± 0.1	%/K
t_{D90}	Delay time to 90 % of the final output value for $I_{PN, step} < 3$		μs
BW	Frequency bandwidth (-3 dB) ²⁾	DC ... 50	kHz

General data

T_A	Ambient operating temperature	-20 ... +80	$^\circ\text{C}$
T_{Ast}	Ambient storage temperature	-25 ... +85	$^\circ\text{C}$
m	Mass	< 36	g
	Standard	EN 50178: 1997	
	2 pins of $\varnothing 2 \text{ mm}$ are available on transducer for PCB soldering.		

Notes: ¹⁾ Operating at $\pm 12 \text{ V} \leq U_C < \pm 15 \text{ V}$ will reduce the measuring range
²⁾ Derating is needed to avoid excessive core heating at high frequency.

Features

- Hall effect measuring principle
- Galvanic separation between primary and secondary circuit
- Insulation voltage 2500 V
- Low power consumption
- Wide supply voltage $\pm 12 \dots 15 \text{ V}$
- Primary bus bar
- Insulating plastic case recognized according to UL 94-V0.

Special feature

- Maximum nominal current 100 A due to bus bar capacity.

Advantages

- Small size and space saving
- Only one design for wide current rating range
- High immunity to external interference.

Applications

- AC variable speed drives and servo motor drives
- Static converters for DC motor drives
- Battery supplied applications
- Uninterruptible Power Supplies (UPS)
- Switched Mode Power Supplies (SMPS)
- Power supplies for welding applications.

Application domain

- Industrial.

Current Transducers HTB 100-TP/SP9

Insulation coordination

U_d	RMS voltage for AC insulation test, 50 Hz, 1 min	2.5	kV
U_t	Partial discharge extinction RMS voltage ($q_m < 10 \text{ pC}$)	> 500	V
U_{Ni}	Impulse withstand voltage 1.2/50 μs	4	kV
CTI	Comparative Tracking Index (group IIIa)	275	

Applications examples

According to EN 50178 and IEC 61010-1 standards and following conditions:

- Over voltage category OV 3
- Pollution degree PD2
- Non-uniform field

	EN 50178	IEC 61010-1
d_{Cp}, d_{Cl}, U_{Ni}	Rated insulation voltage	Nominal voltage
Basic insulation	300 V	300 V
Reinforced insulation	150 V	150 V

Safety

This transducer must be used in limited-energy secondary circuits according to IEC 61010-1.



This transducer must be used in electric/electronic equipment with respect to applicable standards and safety requirements in accordance with the manufacturer’s operating instructions.




Caution, risk of electrical shock

When operating the transducer, certain parts of the module can carry hazardous voltage (eg. primary busbar, power supply). Ignoring this warning can lead to injury and/or cause serious damage.

This transducer is a build-in device, whose conducting parts must be inaccessible after installation. A protective housing or additional shield could be used.

Main supply must be able to be disconnected.

Dimensions HTB 100-TP/SP9 (in mm)

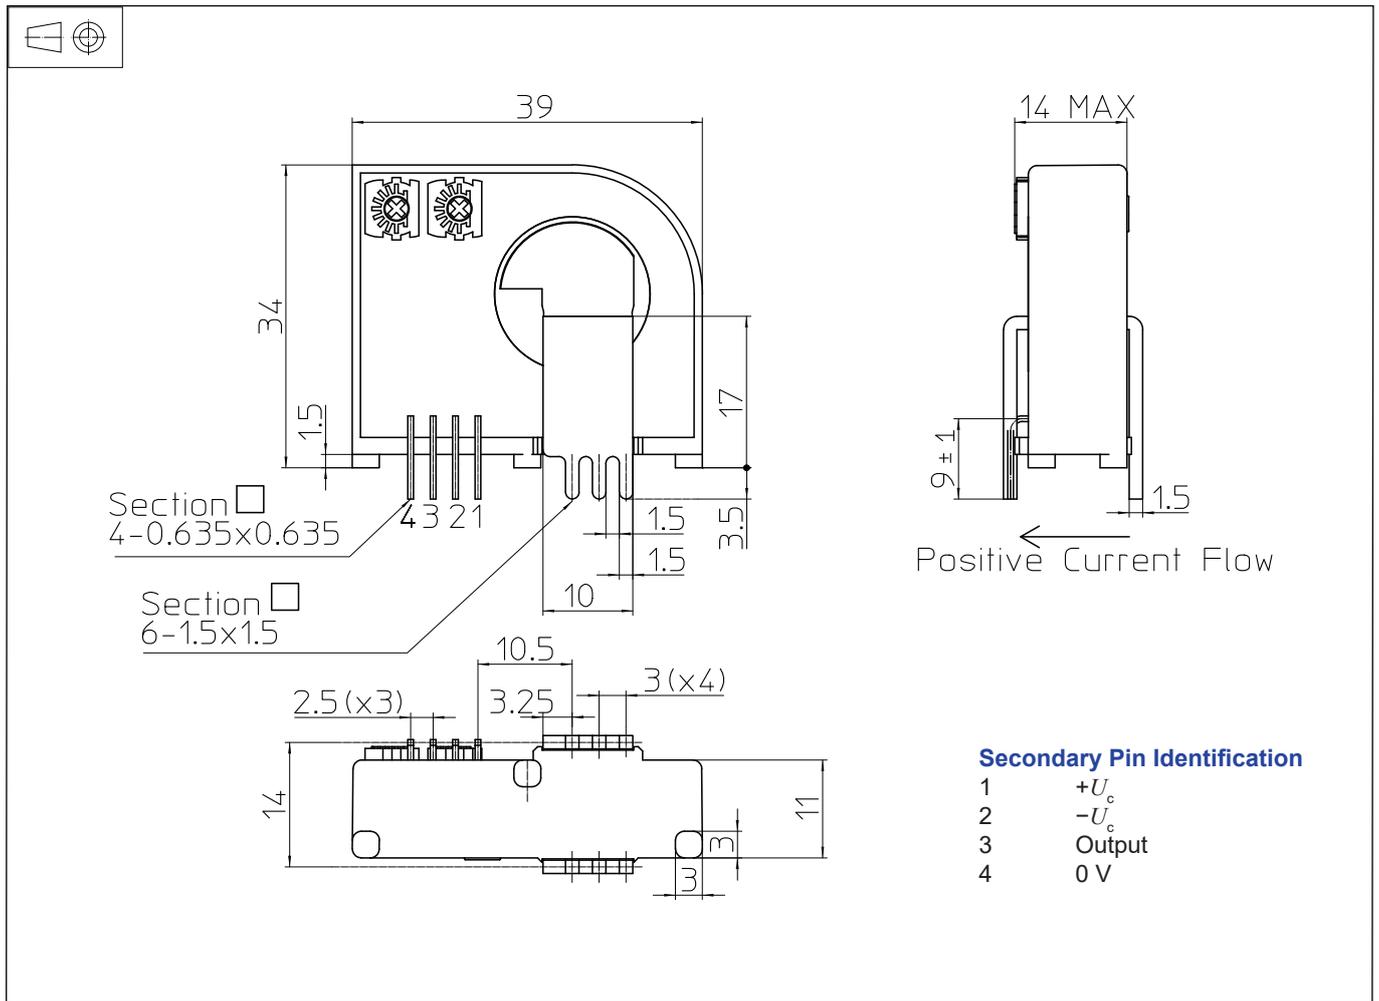

Mechanical characteristics

- General tolerance ±0.5 mm
- Primary through-hole ∅ 16 mm
- Connection of secondary 4 pins
0.35 mm × 0.35 mm

Remarks

- I_s is positive when I_p flows in the direction of the arrow.
- Temperature of the primary conductor should not exceed 100 °C.
- Installation of the transducer must be done unless otherwise specified on the datasheet, according to LEM Transducer Generic Mounting Rules. Please refer to LEM document N°ANE120504 available on our Web site: <https://www.lem.com/en/file/3137/download>